

Etex (Exteriors) UK Ltd

Wellington Road
Burton-upon-Trent
Staffordshire
DE14 2AP

Tel: 01283 501505

e-mail: techuk@etexgroup.com

website: www.cedral.co.uk



Agreement Certificate

06/4299

Product Sheet 1

ETEX (EXTERIORS) UK CLADDING SYSTEM


CEDRAL WEATHERBOARD LAP

This Agrément Certificate Product Sheet⁽¹⁾ relates to Cedral Weatherboard Lap, a fibre-reinforced cement plank for use as exterior non-loadbearing, decorative cladding over timber frame, steel frame or masonry walls of new and existing buildings.

(1) Hereinafter referred to as 'Certificate'.

CERTIFICATION INCLUDES:

- factors relating to compliance with Building Regulations where applicable
- factors relating to additional non-regulatory information where applicable
- independently verified technical specification
- assessment criteria and technical investigations
- design considerations
- installation guidance
- regular surveillance of production
- formal three-yearly review.

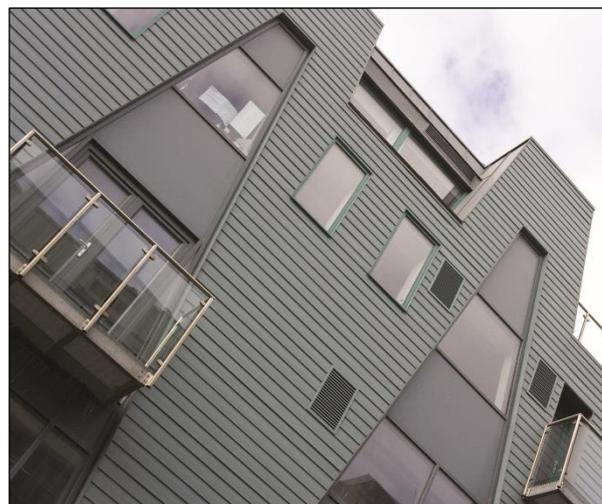

KEY FACTORS ASSESSED

Strength and stability — the product can accept the wind loading and impacts likely to be met in service in the UK (see section 6).

Behaviour in relation to fire — the factory-painted product has an A2-s1, d0 reaction to fire classification in accordance with EN 13501-1 : 2018 (see section 7).

Weathertightness — the product, when installed, is not weathertight and must be used in conjunction with a suitable vapour permeable membrane (see section 8).

Durability — under normal UK conditions, the product can be expected to have a service life in excess of 30 years (see section 10).

The BBA has awarded this Certificate to the company named above for the product described herein. This product has been assessed by the BBA as being fit for its intended use provided it is installed, used and maintained as set out in this Certificate.

On behalf of the British Board of Agrément

Date of Third issue: 17 January 2020

Originally certificated on 13 March 2006

Hardy Giesler
Chief Executive Officer

The BBA is a UKAS accredited certification body – Number 113.

The schedule of the current scope of accreditation for product certification is available in pdf format via the UKAS link on the BBA website at www.bbacerts.co.uk

Readers MUST check the validity and latest issue number of this Agrément Certificate by either referring to the BBA website or contacting the BBA directly.

Any photographs are for illustrative purposes only, do not constitute advice and should not be relied upon.

British Board of Agrément

Bucknalls Lane
Watford
Herts WD25 9BA

©2020

tel: 01923 665300
clientservices@bbacerts.co.uk
www.bbacerts.co.uk

Regulations

In the opinion of the BBA, Cedral Weatherboard Lap, if installed, used and maintained in accordance with this Certificate, can satisfy or contribute to satisfying the relevant requirements of the following Building Regulations (the presence of a UK map indicates that the subject is related to the Building Regulations in the region or regions of the UK depicted):



The Building Regulations 2010 (England and Wales) (as amended)

Requirement: A1 Comment:	Loading The product is acceptable for use as set out in section 6 of this Certificate.
Requirement: B3(4) Comment:	Internal fire spread (structure) The product can contribute to satisfying this Requirement. See section 7.2 of this Certificate.
Requirement: B4(1) Comment:	External fire spread The product is unrestricted by this Requirement. See sections 7.1, 7.2 and 7.5 of this Certificate.
Requirement: C2(b) Comment:	Resistance to moisture The product does not provide a watertight or airtight facing. To achieve a weatherproof barrier, a breather membrane must be provided. See section 8.1 of this Certificate.
Regulation: 7(1) Comment:	Materials and workmanship The product is acceptable. See section 10 and the <i>Installation</i> part of this Certificate.
Regulation: 7(2) Comment:	Materials and workmanship The product is unrestricted by this Regulation. See sections 7.1 and 7.5 of this Certificate.



The Building (Scotland) Regulations 2004 (as amended)

Regulation: 8(1)(2) Comment:	Durability, workmanship and fitness of materials The product can contribute to a construction satisfying this Regulation. See section 10 and the <i>Installation</i> part of this Certificate.
Regulation: 9 Standard: 1.1(a)(b) Comment:	Building standards applicable to construction Structure The product is acceptable, with reference to clause 1.1.1 ⁽¹⁾⁽²⁾ . See section 6 of this Certificate.
Standard: 2.4 Comment:	Cavities The product can contribute to satisfying this Standard with reference to clause 2.4.2 ⁽¹⁾⁽²⁾ . See section 7.2 of this Certificate.
Standard: 2.6 Comment:	Spread to neighbouring buildings The product is classified as 'non-combustible' and is therefore unrestricted under clauses 2.6.5 ⁽¹⁾ and 2.6.6 ⁽²⁾ of this Standard. See sections 7.1, 7.2 and 7.5 of this Certificate.
Standard: 2.7 Comment:	Spread on external walls The product is classified as 'non-combustible' and is therefore unrestricted under clause 2.7.1 ⁽¹⁾⁽²⁾ of this Standard. See sections 7.1, 7.2 and 7.5 of this Certificate.

Standard:	3.10	Precipitation
Comment:		The product does not form a watertight or airtight facing. A breather membrane must be provided to satisfy this Standard, with reference to clause 3.10.5 ⁽¹⁾⁽²⁾ . See section 8.1 of this Certificate.
Standard:	7.1(a)	Statement of sustainability
Comment:		The product can contribute to satisfying the relevant requirements of Regulation 9, Standards 1 to 6, and therefore will contribute to a construction meeting a bronze level of sustainability as defined in this Standard.
Regulation:	12	Building standards applicable to conversions
Comment:		All comments given for the product under Regulation 9, Standards 1 to 6, also apply to this Regulation with reference to clause 0.12.1 ⁽¹⁾⁽²⁾ and Schedule 6 ⁽¹⁾⁽²⁾ .
		(1) Technical Handbook (Domestic). (2) Technical Handbook (Non-Domestic).



The Building Regulations (Northern Ireland) 2012 (as amended)

Regulation:	23(a)(i)(iii)(b)(i)	Fitness of materials and workmanship
Comment:		The product is acceptable. See section 10 and the <i>Installation</i> part of this Certificate.
Regulation:	28(b)	Resistance to moisture and weather
Comment:		The product does not form a watertight or airtight facing. To achieve a weatherproof barrier, a breather membrane must be provided. See section 8.1 of this Certificate.
Regulation:	30	Stability
Comment:		The product is acceptable for use as set out in section 6 of this Certificate.
Regulation:	35(4)	Internal fire spread – Structure
Comment:		The product can contribute to satisfying this Regulation. See section 7.2 of this Certificate.
Regulation:	36(a)	External fire spread
Comment:		The product is unrestricted by this Regulation. See sections 7.1, 7.2 and 7.5 of this Certificate.

Construction (Design and Management) Regulations 2015

Construction (Design and Management) Regulations (Northern Ireland) 2016

Information in this Certificate may assist the client, designer (including Principal Designer) and contractor (including Principal Contractor) to address their obligations under these Regulations.

See section: 3 *Delivery and site handling* (3.1 and 3.3) of this Certificate.

Additional Information

NHBC Standards 2020

In the opinion of the BBA, Cedral Weatherboard Lap, if installed, used and maintained in accordance with this Certificate, can satisfy or contribute to satisfying the relevant requirements in relation to NHBC Standards, Part 6 *Superstructures (excluding roofs)*, Chapter 6.9 *Curtain walling and cladding*.

CE marking

The Certificate holder has taken the responsibility of CE marking the product in accordance with harmonised European standard BS EN 12467 : 2012.

Technical Specification

1 Description

1.1 Cedral Weatherboard Lap comprises semi-compressed, autoclaved fibre-reinforced Portland cement planks, for use as exterior cladding over timber frame, steel frame or masonry walls. The product is available in a smooth or textured finish, with the following nominal characteristics:

Thickness (mm)	10
Width (mm)	190
Length (mm)	3600
Mass per plank (kg)	11.2
Mechanical resistance	Class 2 ⁽¹⁾
Durability category	Category A ⁽²⁾
Density (kg·m ⁻³)	1300
Water permeability	Pass
Dimensional variations	Pass
Durability against warm water	Pass
Durability against soak/dry	Pass
Durability against freeze/thaw	Pass
Durability against heat/rain	Pass.

(1) Class 2 — minimum Modulus of Rupture (MOR) in the wet condition is 7MPa.

(2) Category A— sheets intended for applications where they may be subjected to heat, high moisture and severe frost.

1.2 The product is supplied factory coated and is available in the following colours:

- Grey Brown, Atlas Brown, Taupe, Burnt Red, Light Oak, Dark Oak, Cream White, Beige, Sand Yellow, Sage Green, Forest Grey, Dark Brown, White, Silver Grey, Grey, Pearl, Pewter, Black, Grey Green, Blue Grey, Violet Blue, Dark Grey, Slate Grey.

1.3 The following fixings⁽¹⁾ are used for attaching the planks to a metal profile subframe (see section 1.6 for details):

- stainless steel (grade 304 [A2]) screw fixings 32 x 4.5 mm, with a 7 mm diameter head

(1) Stainless steel grade 304 can be used in non-aggressive areas at any height in accordance with note 4 under Table 2 in PD 6697 : 2019. Stainless steel grade 316 can be used in aggressive or non-aggressive areas at any height, thus for the most aggressive environments, stainless steel grade 316 (A4) screw fixings are recommended by the Certificate holder.

1.4 The following fixings⁽¹⁾ are used for attaching the planks to a timber subframe (see section 1.6 for details):

- stainless steel (grade 304 [A2]) screw fixings 38 x 4.8 mm, with a 12 mm diameter head
- stainless steel (grade 304 [A2]) screw fixings 45 x 4 mm, with a 7.5 mm diameter head.

(1) As footnote in 1.3

Ancillary items

1.5 Also required for the installation of the product, and included in the assessment, are stainless steel ring shank nails used to attach the planks to a timber subframe – 50 by 3.4 mm diameter, with a 10 mm diameter head.

1.6 Other ancillary items which may be used with the product, but which are outside the scope of this Certificate:

- Metal support subframe, consisting of:
 - vertical aluminium 'L' or 'T' shaped support rails (2 mm thick), grade EN AW 6005A T6, in conjunction with support wall brackets, or

- vertical galvanized steel omega support rails (1.5 mm thick), grade 304 (A2)
- Timber support subframe, consisting of:
 - timber battens, 50 x 38 mm, grade C16 or C24 in accordance with BS EN 14081-1: 2016
- breather membrane – when installing Cedral Weatherboard Lap to a solid wall, timber frame or metal stud/frame construction, a breathable membrane in accordance with BS EN 13859-1 : 2014 should be applied behind the battens. Generally, for unfilled/partially filled cavity walls, there is no requirement for a breather membrane
- touch-up paint in 0.5 litre quantities
- Cedral aluminium profiles – asymmetric external corner, symmetric external corner, internal corner, connection profile, end profile, starter profile and perforated closure (suitable for metal or wood)
- EPDM or alternative UV resistant protective strip to prevent moisture ingress, when Cedral Weatherboard Lap is fixed into timber battens
- polyurethane strip – 50 mm width, only when Cedral Weatherboard Lap is fixed into a timber frame.

2 Manufacture

2.1 The product is manufactured by a batch blending operation by the Hatschek process and high-pressure steam autoclaving. In a separate process, the cured, sanded planks are sprayed with an acrylic-based paint finish, prior to packaging and storing.

2.2 As part of the assessment and ongoing surveillance of product quality, the BBA has:

- agreed with the manufacturer the quality control procedures and product testing to be undertaken
- assessed and agreed the quality control operated over batches of incoming materials
- monitored the production process and verified that it is in accordance with the documented process
- evaluated the process for management of nonconformities
- checked that equipment has been properly tested and calibrated
- undertaken to carry out the above measures on a regular basis through a surveillance process, to verify that the specifications and quality control operated by the manufacturer are being maintained.

2.3 The management system of the manufacturer, Eternit N.V, has been assessed and registered as meeting the requirements of BS EN ISO 9001 : 2015 by SGS (Certificate BE 92/021057.01) for the Belgium factory and by DNV-GL (Certificate 107405-20111-AQ-LTU-FINAS) for the Lithuanian factory.

3 Delivery and site handling

3.1 The product is delivered on wrapped pallets with a mass of approximately 1612 kg (144 planks). The planks are interleaved to protect the decorative face. The pallets can only be offloaded by mechanical handling equipment; individual planks can be offloaded manually.

3.2 To avoid surface damage during handling, one plank must not be dragged over the surface of the other. In addition, planks must be carried on their edges.

3.3 The product must be stored on edge or flat, under cover, and on a dry, level surface. Stacks of loose planks must not exceed 1 m in height.

3.4 Every plank in each pallet is marked with a unique manufacturing code.

Assessment and Technical Investigations

The following is a summary of the assessment and technical investigations carried out on Cedral Weatherboard Lap.

Design Considerations

4 Use

4.1 Cedral Weatherboard Lap is satisfactory for use as a decorative and protective exterior cladding fixed horizontally, vertically or diagonally over timber frame, steel frame or masonry walls.

4.2 The designer must ensure that the strength and integrity of the intended substrate is commensurate with that required of the cladding system (see sections 4.3 and 4.4).

4.3 Brickwork or blockwork walls must be constructed in accordance with the relevant sections of BS EN 1996-1-1 : 2005, BS EN 1996-1-2 : 2005, BS EN 1996-2 : 2006 and BS EN 1996-3 : 2006 and their respective UK National Annexes, and either PD 6697 : 2019 or one of the technical specifications given in the national Building Regulations:

England and Wales — Approved Document A1/2, Section 2C

Scotland — Mandatory Standards 1.1 and 1.2, clauses 1.1.1 and 1.2.1, respectively

Northern Ireland — Technical Booklet D, *Structure*.

4.4 Timber frame walls must be constructed in accordance with the relevant sections of BS EN 1995-1-1 : 2004 and its UK National Annex, and preservative treated in accordance with BS 8417 : 2011. Guidance on recommended wood preservation is also given in *NHBC Standards 2020, Part 3 General, Chapter 3.3 Timber preservation (natural solid timber)*.

4.5 Steel frame walls must be constructed in accordance with the relevant sections of BS EN 1993-1-1 : 2005 and its UK National Annex. The installation of vertical support rails must be aligned and fixed directly to the vertical structural metal framework.

4.6 Studding and framing should be adequately supported by noggings to ensure rigidity.

4.7 The product is to be fixed to aqueous copper quaternary ammonium compound (ACQ) preservative-treated, good-quality timber battens to BS EN 14081-1 : 2016, aligned vertically at 400 or 600 mm centres. The minimum batten thickness over timber framework is 38 mm; over masonry substrates, this should be increased to accommodate the 50 mm length of the fixings.

4.8 In accordance with the Certificate holder's guidance, the installation must maintain a minimum 30 mm cavity behind the cladding (from the most rear part of the material to the substructure, or insulation if installed), with minimum 10,000 mm² ventilation slots per metre wall length, in accordance with BS 5250 : 2011. Additional guidance on recommended cavity widths is given in *NHBC Standards 2020, Part 6 Superstructure (excluding roofs), Chapter 6.9 Curtain walling and cladding*.

5 Practicability of installation

The product is designed to be installed by competent contractors experienced with this type of product.

6 Strength and stability

General



6.1 The substrate and supporting structure must be capable of transferring all additional loading due to the installation of the cladding system to the ground in a satisfactory manner. The adequacy of the substrate and supporting structure must be verified by the person or party responsible for the global stability of the building to which the system is applied. Any defects should be made good prior to the system being installed.

6.2 The wind loads on the walls should be calculated, taking into account all relevant factors such as location and topography, in accordance with BS EN 1991-1-4 : 2005 and its UK National Annex. All the factors affecting wind load on each elevation and specific zone of the building must be considered. In accordance with BS EN 1990 : 2002 and its UK National Annex, a partial load factor of 1.5 must be applied to the characteristic values determined from BS EN 1991-1-4 to establish the design wind load to be resisted by the system.

6.3 Installations correctly designed in accordance with this Certificate will safely accommodate the applied design loads due to the self-weight of the system, wind and impact.

6.4 Positive wind load is transferred to the substrate wall directly via compression through the cladding and profiles.

6.5 The designer should ensure that the fixing of the support brackets to the supporting wall has adequate tensile pull-out strength and corrosion resistance (not covered by this Certificate). An appropriate number of site-specific pull-out tests must be conducted on the substrate wall to determine the minimum pull-out resistance to failure of the fixings. The characteristic pull-out resistance should be determined in accordance with the guidance given in EOTA TR055, using 50% of the mean value of the five smallest measured values at the ultimate load.

6.6 When installed in accordance with the requirements of this Certificate, onto timber battens at 600 mm spacing, the product can withstand dynamic wind pressures up to 1.7 kPa.

6.7 A dynamic wind uplift (DWU) test was carried out on a system installed with vertical metal profiles ('Z' galvanized steel rails of 75 x 38 x 75 mm and 3 metres long, with minimum thickness of 1.2 mm) at 600 mm horizontal spacing. Cladding planks were fastened to the vertical metal profiles with 4.2 x 32 mm screws (7 mm diameter head) and a vertical overlap of 30 mm. The design wind load resistance of the system as determined from the DWU test is equal to 2.2 kN·m⁻².⁽¹⁾⁽²⁾

- (1) The design wind load of the system corresponds to the maximum allowed spacing of fixings and profiles, as described in sections 6.7 and 6.8. This fixing and profile configuration, with appropriately selected fixings, can also adequately transfer the product's self-weight, wind and impact loads to a suitable substrate wall.
- (2) The design wind resistance is determined by dividing the ultimate value obtained from a DWU test by a partial factor of 2.0.

6.8 The horizontal local deflection of the supporting structure due to variable loads should be within acceptable limits. The maximum mid-span deflection is L/200, and cantilever deflections is L/150, in accordance with BS EN 1995-1-1 : 2004, where L is the span spacing between supports.

Impact resistance

6.9 A system comprising 10 mm thick Cedral Weatherboard Lap planks (190 mm wide and 2400 mm long, with an overlap of 30 mm), attached to vertical metal profiles (spaced at 600 mm apart), with 4.2 x 32 mm Inox screws, was tested for resistance to hard and soft body impacts. The system was found to be susceptible to damage from soft body impacts, and it is recommended that its use is limited to locations where there is little possibility of such impacts. The test results⁽¹⁾ demonstrate that the Cedral Weatherboard Lap is suitable for Use Categories III and IV, as defined in Table G.2 of EAD 090062-00-0404 : 2018, an extract of which is shown in Table 1 of this Certificate. For the build-up using timber batten supports at 600 mm spacings, the cladding system is likewise suitable for Use Categories III and IV.

- (1) The results apply only to the system configurations tested as described above in clause 6.9

Table 1 Impact categories

Category	Description
I	A zone readily accessible at ground level to the public and vulnerable to hard body impacts but not subjected to abnormally rough use.
II	A zone liable to impacts from thrown or kicked objects, but in public locations where the height of the kit will limit the size of the impact; or at lower levels where access to the building is primarily to those with some incentive to exercise care.
III	A zone not likely to be damaged by normal impacts caused by people or by thrown or kicked objects.
IV	A zone out of reach from ground level.

Note: Categories I and II are shown for information only and are not suitable for this product.

7 Behaviour in relation to fire

 7.1 The product has an A2-s1, d0 classification in accordance with EN 13501-1 : 2018. This relates to the thickness and colour range referred to in section 1 of this Certificate, as per the reaction to fire classification report Nr 15090D by Warringtonfiregent.

7.2 The reverse side of the plank (facing into the cavity) has a reaction to fire classification of A2-s1, d0 to EN 13501-1 : 2018.

7.3 The fixings and metal support system are classified as 'non-combustible' or of limited combustibility in accordance with the relevant national regulatory guidance.

7.4 Designers should refer to the relevant national Building Regulations and guidance for alternative approaches and detailed conditions of use, particularly in respect of requirements for substrate fire performance, cavity barriers and combustibility limitations for other materials and components used in the overall wall construction (for example, timber battens, thermal insulation).



7.5 The planks are not subject to any restriction on building height or proximity to boundaries.

8 Weathertightness



8.1 The product is not weathertight and when used on timber or steel frame walls must be backed by a breather membrane in conjunction with sheathing boards acting as a vapour-permeable water barrier (see section 1.6), incorporated behind the cladding under the supporting battens or metal subframe. This barrier must satisfy the requirements of BS 5250 : 2011 and have a vapour resistance less than $0.6 \text{ MN}\cdot\text{s}\cdot\text{g}^{-1}$.

8.2 Where the product is used as a decorative facing attached to weathertight masonry walls, an additional waterproofing layer is not necessary as the amount of water that will penetrate the cladding will be small and will not have an adverse effect on the wall. See section 4.3 of this Certificate and BRE Report BR 262 : 2002.

8.3 If the product is used in the renovation of an existing masonry wall which is structurally sound but not fully weathertight, a vapour-permeable membrane should be installed.

8.4 The horizontal lapped joints between planks are not sealed but the amount of water entering the cavity by wind-driven rain will be minimal. Any water collecting in the cavity owing to rain or condensation will be removed by drainage and ventilation.

8.5 Provision must always be made to allow water that has penetrated behind the cladding to drain away.

8.6 The clear cavity between the back of the product and the supporting wall must be at least 30 mm.

9 Maintenance

Periodic inspections should be carried out to assess the need for cleaning, maintenance painting, localised repairs and replacement of elements, such as joint seals and fixings. Advice regarding re-coating and maintenance procedures can be obtained from the Certificate holder.

Note: Care must be taken to ensure that over coating does not reduce the required reaction to fire classification.

10 Durability



10.1 When installed in accordance with this Certificate and the Certificate holder's instructions, and subjected to normal conditions of exposure and use, the product will have a service life in excess of 30 years.

10.2 In common with other cementitious materials (eg masonry blocks), the fibre-cement planks can become brittle with time. This can be minimised by the selection of an appropriate factory coating and by regular maintenance painting.

10.3 The factory applied coating is tough and durable and adheres well to the substrate. Care must be taken to ensure that objects such as ladders are not repeatedly leant or rubbed against the planks.

10.4 The factory applied paint finish has a satisfactory colour stability for up to 15 years. Extensive exposure to sunlight will cause some fading of the surface colour. The extent of the fading will depend upon the colour chosen, environment, location and aspect.

11 General

11.1 Cedral Weatherboard Lap is installed on external braced timber frame, steel frame or masonry walls in accordance with the provisions of this Certificate and the Certificate holder's instructions, by suitably experienced and trained personnel. Full installation details are given in the Certificate holder's installation manual.

11.2 Planks can be cut using a fine-tooth tungsten carbide handsaw, diamond-dusted handsaw, power saw or guillotine.

12 Procedure

12.1 Where required, a breather membrane is laid parallel to the direction of the planks along the wall and behind the timber frame, with minimum overlaps of 150 mm.

12.2 Timber wall battens or metal profiles are fixed over the breather membrane at a maximum of 600 mm centres, in accordance with sections 4.6 and 4.7.

12.3 A ventilation gap of at least 30 mm (see section 4.8) must be provided between the back of the cladding planks and the substrate wall or external wall insulation (if installed within the cavity). The starter profile and perforated closure are fitted at the base, with the perforated closure also installed above and below window/door heads and the top of the cladding. Refer to the manufacturer's guidance for the installation procedure of ancillary items.

12.4 A starter profile is fixed along the front face of the battens, allowing at least 150 mm between the bottom edge of the plank and ground level (see Figures 1 and 2), with appropriate wall protection as described in section 8.1 of this Certificate.

12.5 The first course of the product is installed using the fixings described in section 1, in accordance with the Certificate holder's instruction. The Cedral Weatherboard Lap plank should sit fully onto the starter profile.

12.6 Subsequent courses are installed in the same way, allowing a 30 mm vertical overlap of the lower edge over the previous row.

12.7 Where joints are required, the planks are loosely butted with moderate contact to form a joint, which must coincide with a timber support. A 50 mm polyurethane weather strip is installed directly behind the joint to protect the batten. Caution should be taken to avoid straddling plank fixings across movement joints in the substrate wall (see Figures 1 and 2).

12.8 At corners, the product can be close-mitred for neat finishing. Alternatively, the symmetric external corner colour-matched profile can be used to finish external corners of the building, whilst the asymmetric external corner colour-matched profile can be used to finish the window/door reveal corners (see Figures 1 and 2).

Figure 1 Typical installation details for Cedral Weatherboard Lap fixed to timber support frame


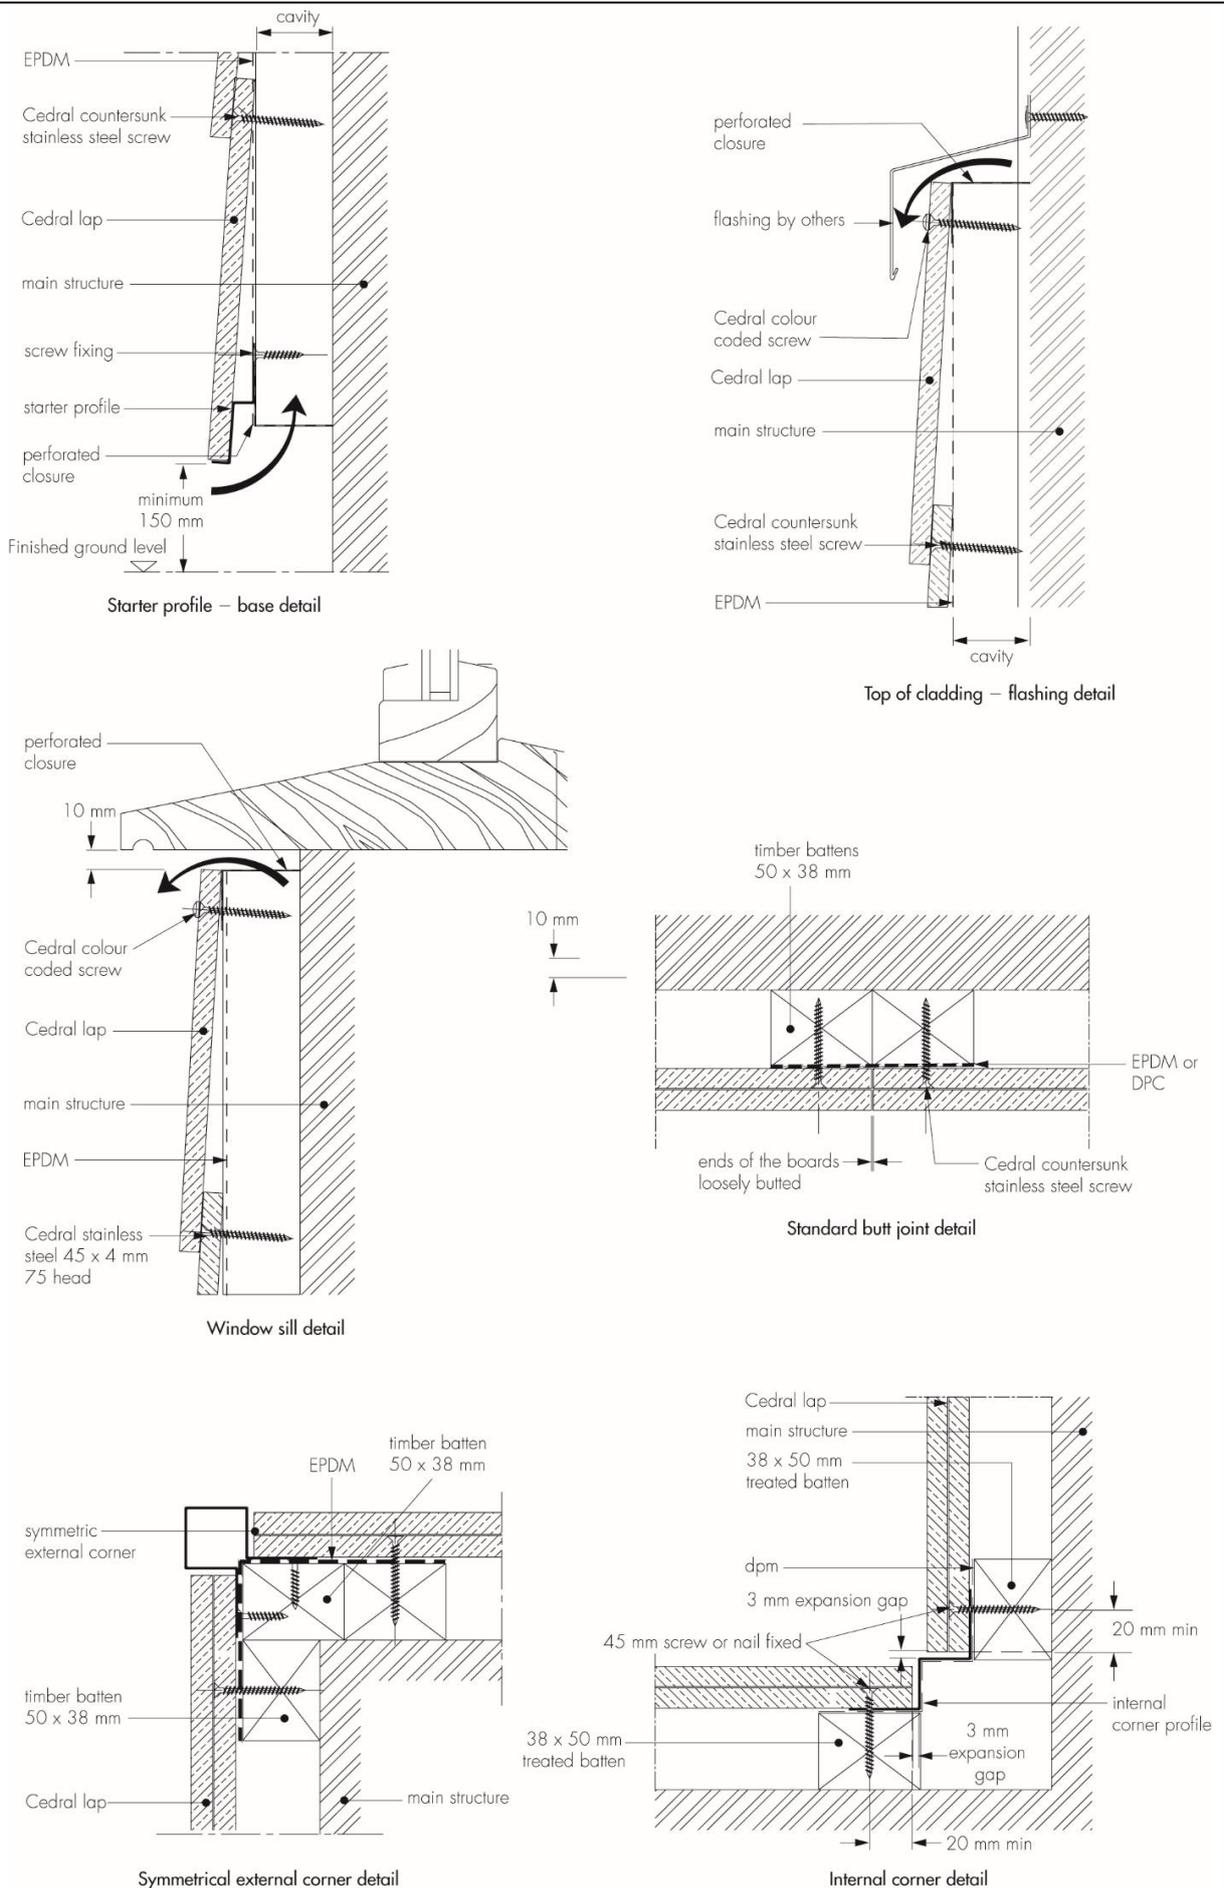


Figure 2 Typical installation details for Cedral Weatherboard Lap fixed to metal support frame

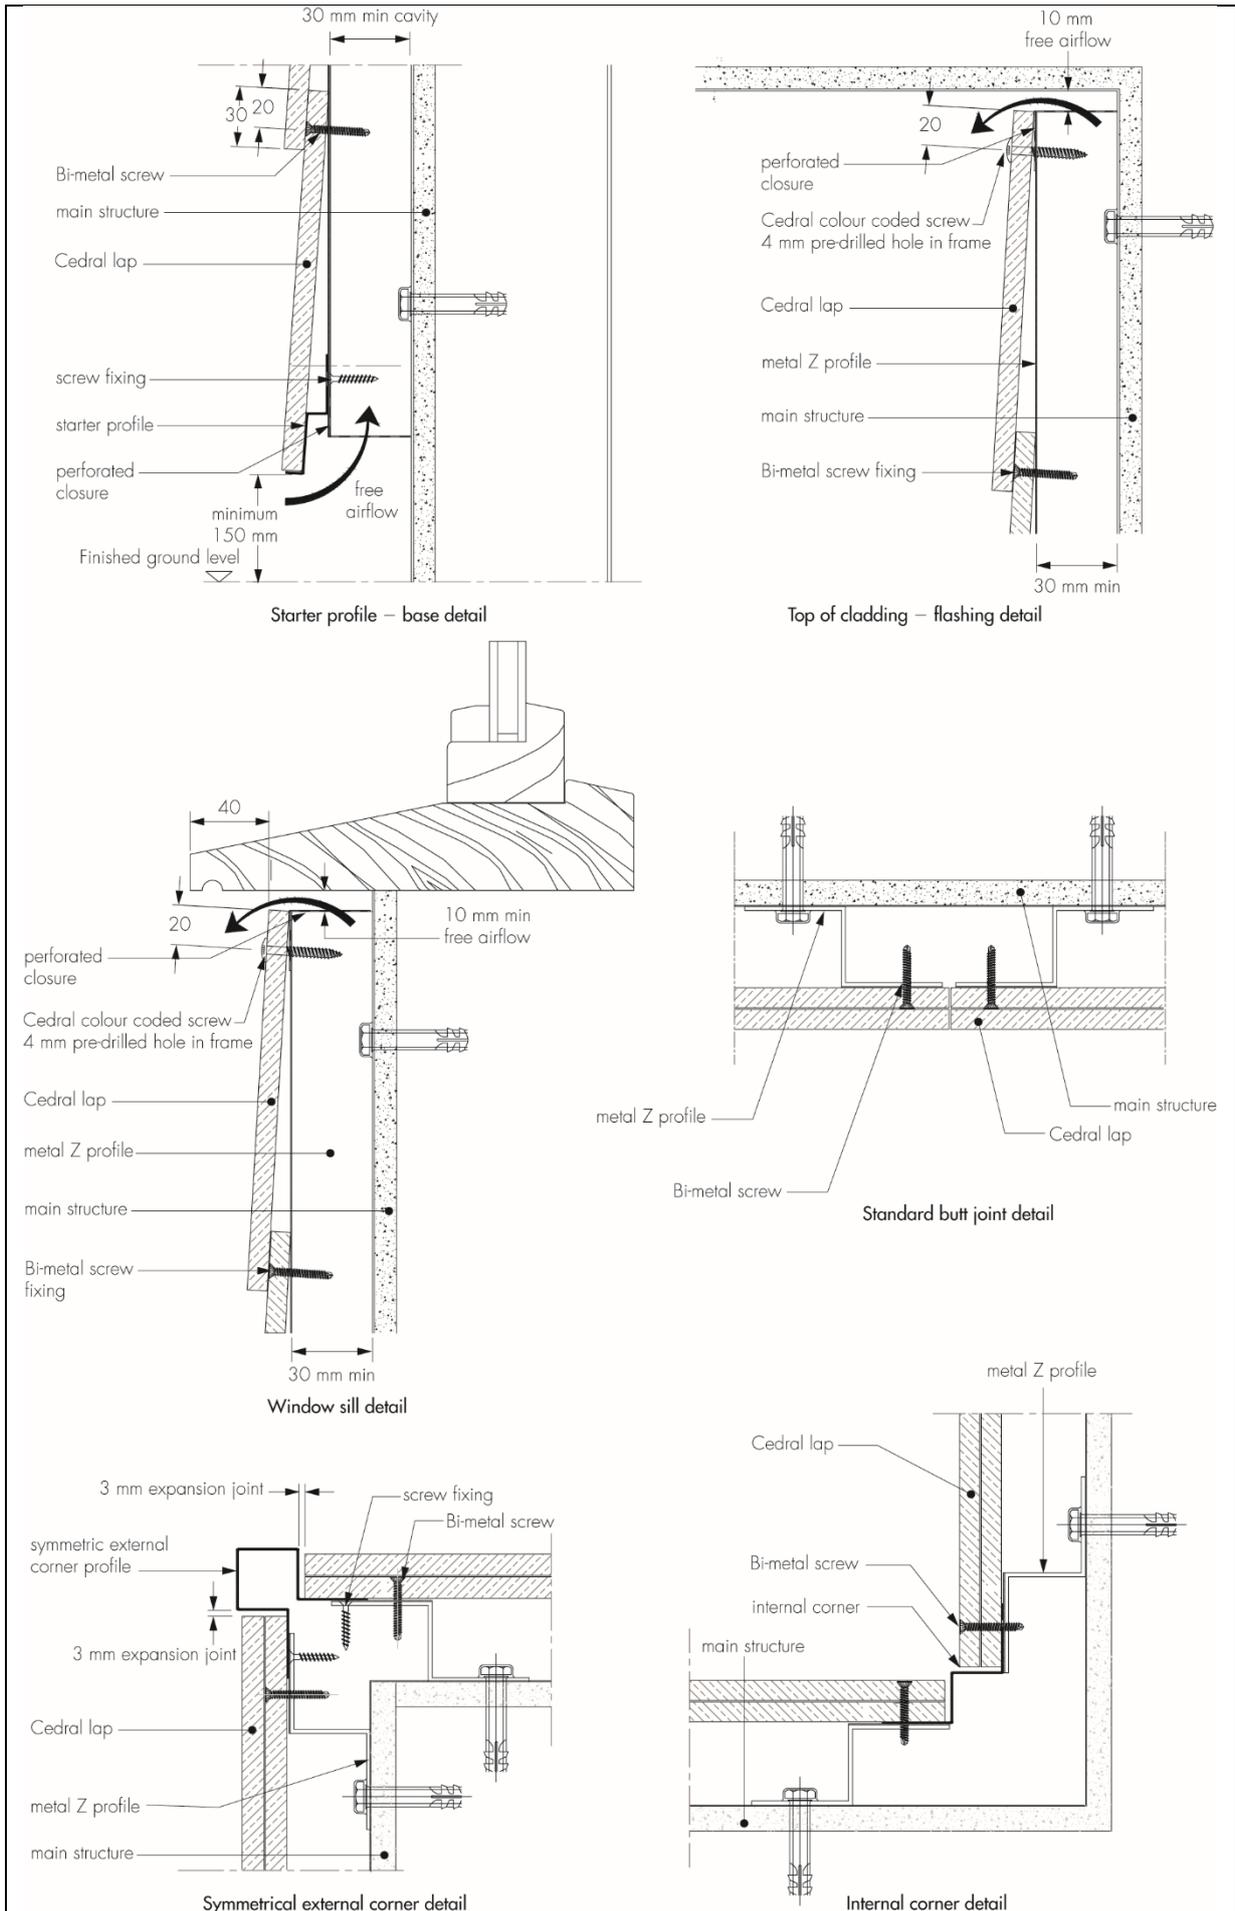

13 Repair

Under normal conditions of use, the product is unlikely to suffer damage, but should it occur, repairs can be carried out by replacement of damaged planks. This may require the temporary removal of undamaged planks above the damaged area. The detailed repair instructions are available from the Certificate holder.

Technical Investigations

14 Tests

14.1 An assessment was made of data to BS EN 12467 : 2012 in relation to:

- dimensions
- bending strength
- apparent density
- resistance to freeze/thaw
- resistance to water soak
- resistance to soak/dry cycling
- resistance to heat/rain cycling
- water impermeability.

14.2 Tests were carried out to determine:

- water absorption
- resistance to hard body impact
- resistance to soft body impact
- wind load resistance
- pull-out of fixings
- pull-through of fixings
- resistance to water penetration
- resistance to algal growth
- abrasion resistance

in order to assess:

- safety and performance when installed
- durability of coated products.

14.3 Existing test data from a product of similar specification was assessed relating to:

- adhesion to substrate
- accelerated weathering and colour stability
- resistance to chemicals, marking and staining.

15 Investigations

An evaluation was made of existing data in relation to:

- reaction to fire tests and classification to EN 13501-1 : 2018
- salt-spray test
- exposure to sulfur dioxide.

Bibliography

- BRE Report BR 262 : 2002 *Thermal insulation – avoiding risks*
- BS 5250 : 2011 + A1 : 2016 *Code of practice for control of condensation in buildings*
- BS 8417 : 2011 + A1 : 2014 *Preservation of wood — Code of practice*
- BS EN 1990 : 2002 *Eurocode : Basis of structural design*
- NA to BS EN 1990 : 2002 *Eurocode : Basis of structural design*
- BS EN 1991-1-4 : 2005 + A1 : 2010 *Eurocode 1 : Actions on structures — General actions — Wind actions*
- NA to BS EN 1991-1-4 : 2005 UK National Annex to *Eurocode 1 : Actions on structures — General actions — Wind actions*
- BS EN 1993-1-1 : 2005 + A1 : 2014 *Eurocode 3 : Design of steel structures — General rules and rules for buildings*
- NA + A1 : 2014 to BS EN 1993-1-1 : 2005 + A1 : 14 UK National Annex to *Eurocode 3 : Design of steel structures — General rules and rules for buildings*
- BS EN 1995-1-1 : 2004 + A2 : 2014 *Eurocode 5 : Design of timber structures — General — Common rules and rules for buildings*
- NA to BS EN 1995-1-1 : 2004 + A1 : 2008 UK National Annex to *Eurocode 5 : Design of timber structures — General — Common rules and rules for buildings*
- BS EN 1996-1-1 2005 + A1 : 2012 *Eurocode 6 : Design of masonry structures — General rules for reinforced and unreinforced masonry structures*
- NA to BS EN 1996-1-1 : 2005 UK National Annex to *Eurocode 6 : Design of masonry structures — General rules for reinforced and unreinforced masonry structures*
- BS EN 1996-1-2 : 2005 *Eurocode 6 : Design of masonry structures — General rules — Structural fire design*
- NA to BS EN 1996-1-2 : 2005 UK National Annex to *Eurocode 6 : Design of masonry structures — General rules — Structural fire design*
- BS EN 1996-2 : 2006 *Eurocode 6 : Design of masonry structures — Design considerations, selection of materials and execution of masonry*
- NA to BS EN 1996-2 : 2006 UK National Annex to *Eurocode 6 : Design of masonry structures — Design considerations, selection of materials and execution of masonry*
- BS EN 1996-3 : 2006 *Eurocode 6 : Design of masonry structures — Simplified calculation methods for unreinforced masonry structures*
- NA to BS EN 1996-3 : 2006 UK National Annex to *Eurocode 6: Design of masonry structures — Simplified calculation methods for unreinforced masonry structures*
- BS EN 12467 : 2012 + A2 : 2018 *Fibre-cement flat sheets — Product specification and test methods*
- BS EN 13859-1 : 2014 *Flexible sheets for waterproofing — Definitions and characteristics of underlays — Underlays for discontinuous roofing*
- BS EN 14081-1 : 2016 + A1 : 2019 *Timber structures – Strength graded structural timber with rectangular cross section – General requirements*
- BS EN ISO 9001 : 2015 *Quality management systems — Requirements*
- EN 13501-1 : 2018 *Fire classification of construction products and building elements — Classification using data from reaction to fire tests*
- EAD 090062-00-0404 : 2018 *Kits for external wall claddings mechanically fixed*
- PD 6697 : 2019 *Recommendations for the design of masonry structures to BS EN 1996-1-1 and BS EN 1996-2*
- TR055 *Design of fastenings based on EAD 330232-00-0601, EAD 330499-00-0601 and EAD 330747-00-06-01*

16 Conditions

16.1 This Certificate:

- relates only to the product/system that is named and described on the front page
- is issued only to the company, firm, organisation or person named on the front page – no other company, firm, organisation or person may hold or claim that this Certificate has been issued to them
- is valid only within the UK
- has to be read, considered and used as a whole document – it may be misleading and will be incomplete to be selective
- is copyright of the BBA
- is subject to English Law.

16.2 Publications, documents, specifications, legislation, regulations, standards and the like referenced in this Certificate are those that were current and/or deemed relevant by the BBA at the date of issue or reissue of this Certificate.

16.3 This Certificate will remain valid for an unlimited period provided that the product/system and its manufacture and/or fabrication, including all related and relevant parts and processes thereof:

- are maintained at or above the levels which have been assessed and found to be satisfactory by the BBA
- continue to be checked as and when deemed appropriate by the BBA under arrangements that it will determine
- are reviewed by the BBA as and when it considers appropriate.

16.4 The BBA has used due skill, care and diligence in preparing this Certificate, but no warranty is provided.

16.5 In issuing this Certificate the BBA is not responsible and is excluded from any liability to any company, firm, organisation or person, for any matters arising directly or indirectly from:

- the presence or absence of any patent, intellectual property or similar rights subsisting in the product/system or any other product/system
- the right of the Certificate holder to manufacture, supply, install, maintain or market the product/system
- actual installations of the product/system, including their nature, design, methods, performance, workmanship and maintenance
- any works and constructions in which the product/system is installed, including their nature, design, methods, performance, workmanship and maintenance
- any loss or damage, including personal injury, howsoever caused by the product/system, including its manufacture, supply, installation, use, maintenance and removal
- any claims by the manufacturer relating to CE marking.

16.6 Any information relating to the manufacture, supply, installation, use, maintenance and removal of this product/system which is contained or referred to in this Certificate is the minimum required to be met when the product/system is manufactured, supplied, installed, used, maintained and removed. It does not purport in any way to restate the requirements of the Health and Safety at Work etc. Act 1974, or of any other statutory, common law or other duty which may exist at the date of issue or reissue of this Certificate; nor is conformity with such information to be taken as satisfying the requirements of the 1974 Act or of any statutory, common law or other duty of care.